



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy/

NOTICE OF ACCEPTANCE (NOA)

F.P.G. Wholesale, Inc.
7190 Coral Way
Miami, FL 33155

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (in Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "Condoor" 8'0" Outswing Glazed Wood Door with & without Sidelites – N.I.

APPROVAL DOCUMENT: Drawing No. W08-35, titled "Outswing Wood Patio Door (N.I.)", sheets 1 through 8 of 8, dated 04/04/08 with revision "B" dated 04/27/12, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E., bearing the Miami-Dade County Product Control renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA # 12-0514.19 and consists of this page 1, evidence submitted pages E-1 & E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**



Helmy A. Makar
07/18/2013

NOA No. 13-0510.02
Expiration Date: 06/19/2018
Approval Date: 07/18/2013
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. *Manufacturer's die drawings and sections.
(Submitted under previous NOA No. 08-0422.08)*
2. *Drawing No. W08-35, titled "Outswing Wood Patio Door (N.I.)", sheets 1 through 8 of 8, dated 04/04/08 with revision "B" dated 04/27/12, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E.*

B. TESTS

1. *Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94*
 1. *Uniform Static Air Pressure Test, Loading per FBC TAS 202-94*
 2. *Water Resistance Test, per FBC, TAS 202-94*
 3. *Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94**along with marked-up drawings and installation diagram of outswing wood French doors w/sidelites, prepared by Hurricane Engineering and Testing, Inc., Test Reports No. 's HETI-07-4174, HETI-07-4175 and HETI-07-4176, dated 11/15/07, all signed and sealed by Candido F. Font, P. E.
(Submitted under previous NOA No. 08-0422.08)*

C. CALCULATIONS

1. *Anchor verification calculations and structural analysis, complying with FBC-2010, prepared by Al-Farooq Corporation, dated 05/08/12, signed and sealed by Javad Ahmad, P. E.*
2. *Glazing complies with ASTM E1300-04.*

D. QUALITY ASSURANCE


1. *Miami-Dade Department of Permitting, Environment, and Regulatory Affairs (PERA).*

E. MATERIAL CERTIFICATIONS

1. *None.*

F. STATEMENTS

1. *Statement letter of no financial interest, conformance and complying with FBC-2010, issued by Al-Farooq Corporation, dated 04/25/12, signed and sealed by Javad Ahmad, P. E.*
2. *Test Proposal issued by Product Control, dated 5/24/06, signed by Jaime Gascon, P.E.
(Submitted under previous NOA No. 08-0422.08)*



Helmy A. Makar, P. E., M. S.
Product Control Unit Supervisor
NOA No. 13-0510.02
Expiration Date: 06/19/2018
Approval Date: 07/18/2013

NOTICE OF ACCEPTANCE:EVIDENCE SUBMITTED

3. *Laboratory compliance letter for Test Reports No.'s HETI-07-4174, HETI-07-4175 and HETI-07-4176, issued by Hurricane Engineering and Testing, Inc., dated 11/15/07, all signed and sealed by Candido F. Font, P. E.
(Submitted under previous NOA No. 08-0422.08)*

G. OTHERS

1. *Notice of Acceptance No. 08-0422.08, issued to F.P.G. Wholesale, Inc. for their Series "Condoor Outswing Glazed Wood Door with & without Sidelites – N.I.", approved on 06/19/08 and expiring on 06/19/13.*

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. *Drawing No. W08-35, titled "Outswing Wood Patio Door (N.I.)", sheets 1 through 8 of 8, dated 04/04/08 with revision "B" dated 04/27/12, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE


1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS



1. *None.*

F. STATEMENTS

1. *Statement letter of conformance and complying with FBC-2010, issued by Al-Farooq Corporation, dated 04/22/13, signed and sealed by Javad Ahmad, P. E.*



Helmy A. Makar, P. E., M. S.
Product Control Unit Supervisor
NOA No. 13-0510.02
Expiration Date: 06/19/2018
Approval Date: 07/18/2013

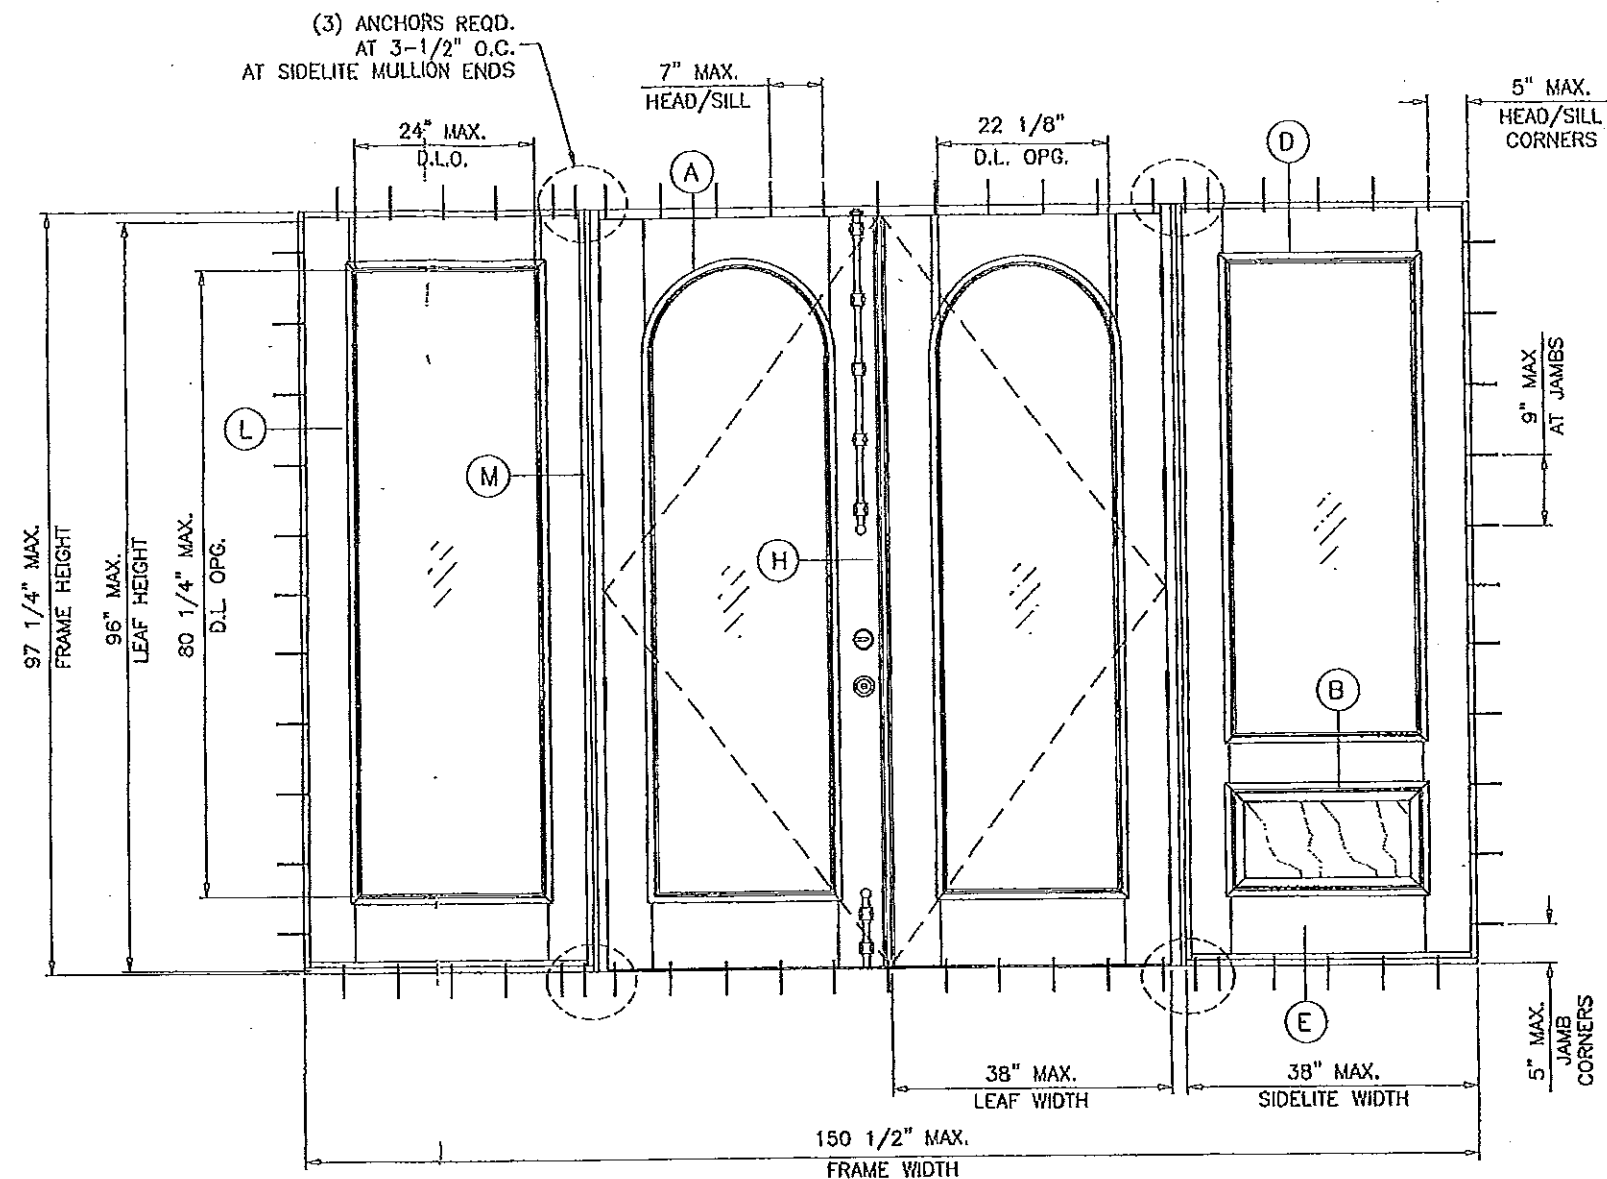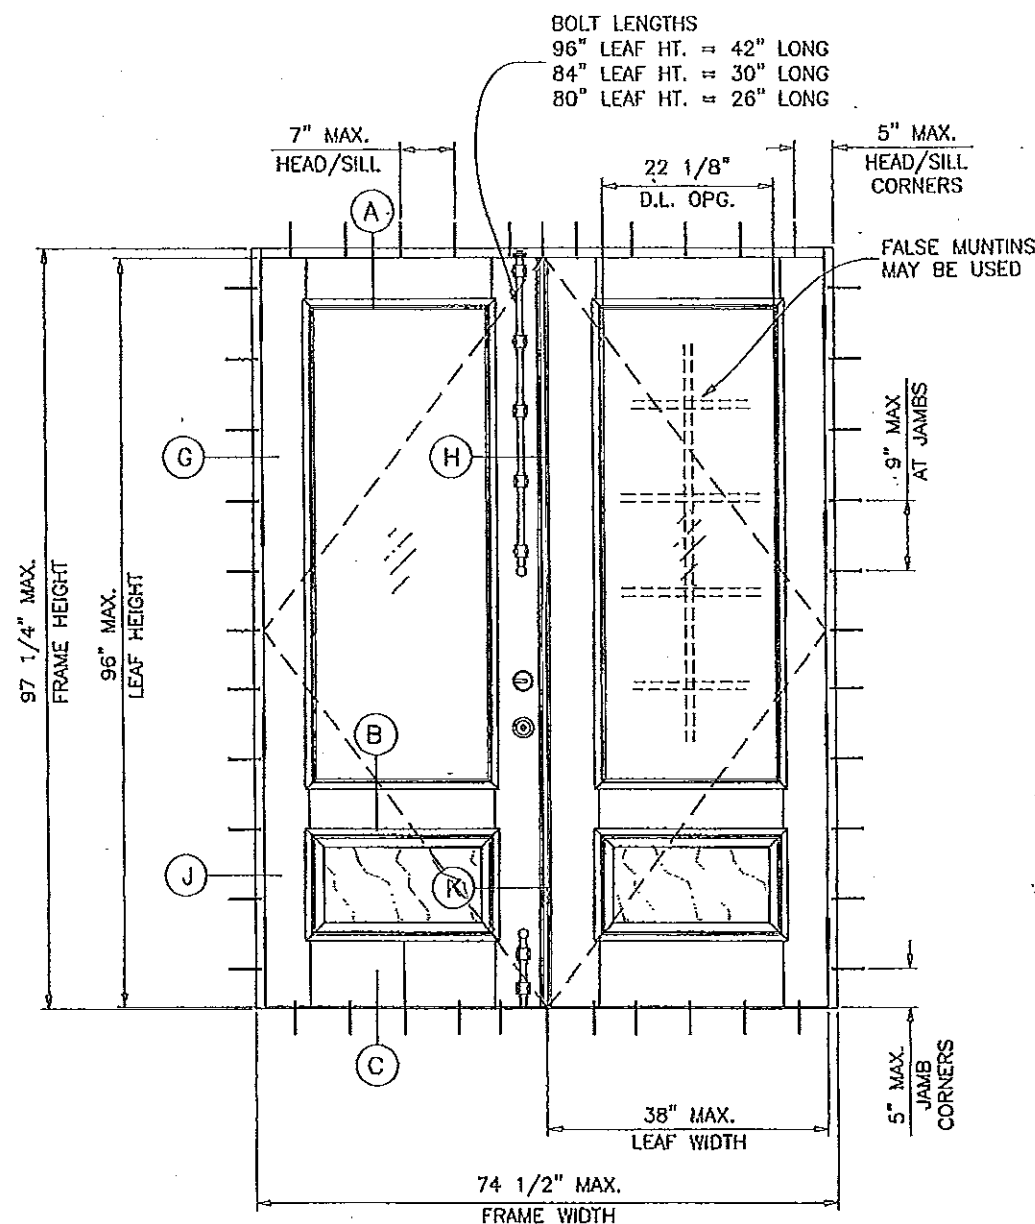

TYPICAL ELEVATIONS

OUT-SWING WOOD PATIO DOOR

APPROVAL APPLIES TO SINGLE (X) AND DOUBLE (XX) LEAF DOORS WITH OR WITHOUT SIDELITES.
 SIDE LITES CAN BE ON ONE SIDE OR BOTH SIDES OF DOOR.
 SEE SHEET 2 FOR DESIGN LOAD CAPACITY.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BLDG. CODE SECTION 2003.8.4.

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 13-0510-02
 Expiration Date 06/19/2018
 By: [Signature]
 Miami Data Product Control

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0514-19
 Expiration Date 06/19/2013
 By: [Signature]
 Miami Data Product Control

INSULATING GLASS
 MONOLITHIC GLASS
 SOLID WOOD INSERTS
 NON IMPACT

DOORS/SIDELITES NOT RATED FOR IMPACT.

INSTALLATION OF THIS PRODUCT IN THE HVHZ AREA REQUIRES THE USE OF APPROVED SHUTTERS OR EXTERNAL PROTECTION DEVICES COMPLYING WITH HVHZ REQUIREMENTS.

INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

Engr: JAVAD, AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

MAY 08 2012

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W08-35FPG

OUT-SWING WOOD PATIO DOOR (N.I.)

F.P.G. WHOLESALE INC.
 7190 CORAL WAY
 MIAMI, FLORIDA 33155
 TEL (305) 266-2296 FAX (305) 261-6540


no	date	by	description
A	10.16.08	REV. PER BCCO COMMENTS	
B	04.27.12	UPDATED TO 2010 FBC	

date: 04-04-08
 scale: 1/2"=1'-0"
 dr. by: HAMID
 chk. by:


drawing no.
W08-35

sheet 1 of 8

SINGLE LEAF (X) OR DOUBLE LEAF (XX) DOORS			
DESIGN LOAD CAPACITY - PSF			
LEAF WIDTH FT./IN.	LEAF HEIGHT FT./IN.	GLAZING TYPES 'B', 'C', 'D' OR 'E'	
		EXT. (+)	INT. (-)
2/0	6/8	60.0	72.9
2/6		60.0	72.9
3/0		60.0	72.9
3/2		60.0	72.9
2/0	7/0	60.0	69.5
2/6		60.0	69.5
3/0		60.0	69.5
3/2		60.0	69.5
2/0	8/0	60.0	60.0
2/6		60.0	60.0
3/0		60.0	60.0
3/2		60.0	60.0

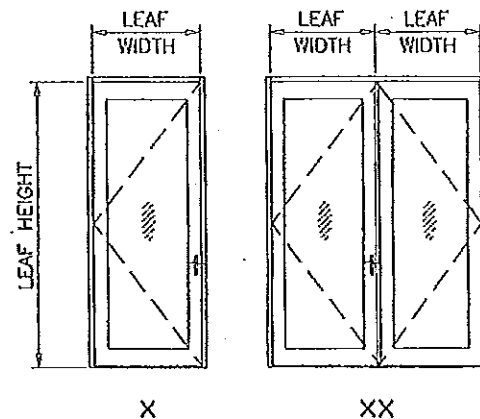


STATIONARY PANEL (O) OR DOORS WITH SIDELITES			
DESIGN LOAD CAPACITY - PSF			
WIDTH (W) INCHES	LEAF HEIGHT FT./IN.	GLAZING TYPES 'B', 'C', 'D' OR 'E'	
		EXT. (+)	INT. (-)
2/0	6/8	60.0	72.9
2/6		60.0	72.9
3/0		60.0	72.9
3/2		60.0	72.9
2/0	7/0	60.0	69.5
2/6		60.0	69.5
3/0		60.0	69.5
3/2		60.0	69.5
2/0	8/0	60.0	60.0
2/6		60.0	60.0
3/0		60.0	60.0
3/2		60.0	60.0

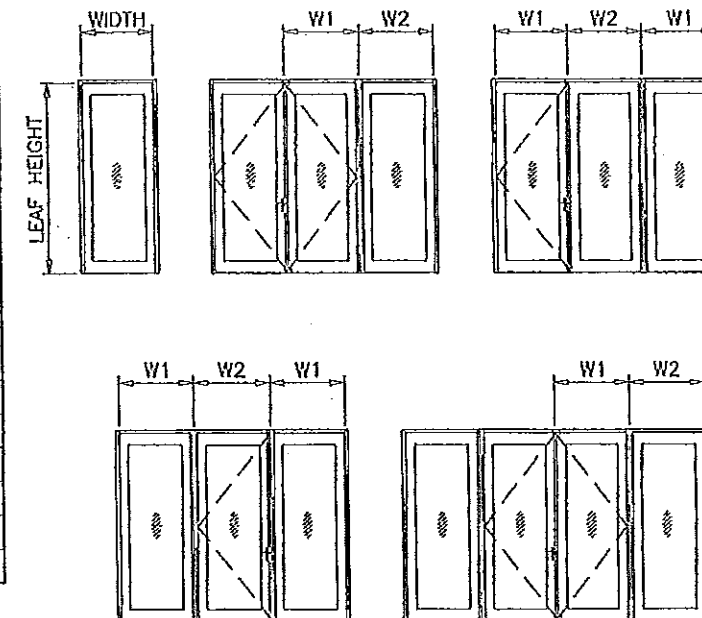


$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

(FOR DOORS WITH SIDELITES)


NOTE:
GLASS CAPACITIES ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

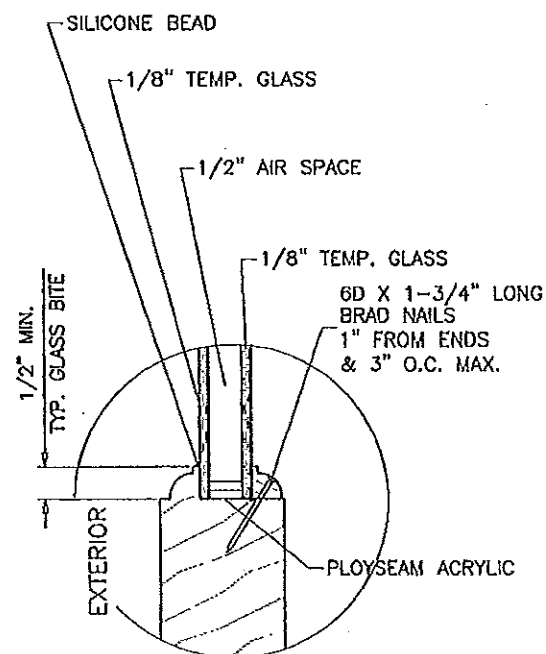


GLAZING TYPE 'B'
3/4" THICKNESS NOMINAL

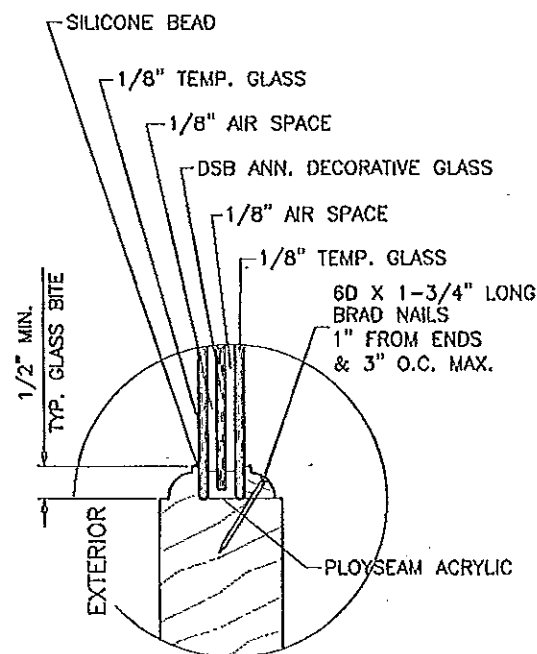

GLAZING TYPE 'C'
11/16" THICKNESS NOMINAL

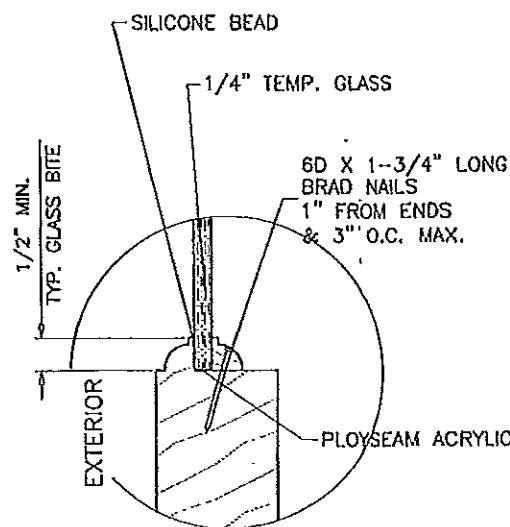

GLAZING TYPE 'D'
11/16" THICKNESS NOMINAL

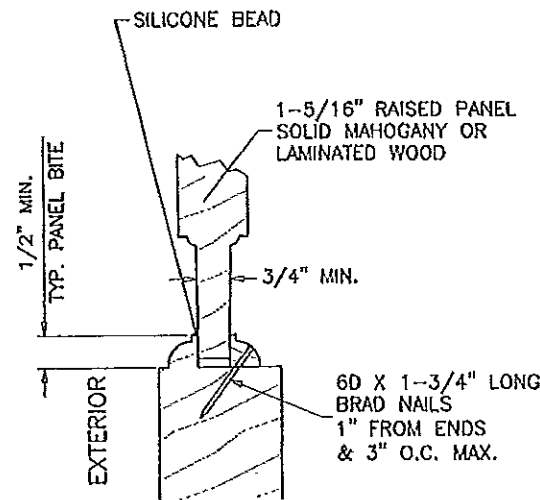

GLAZING TYPE 'E'
11/16" THICKNESS NOMINAL

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 13-0510-02
Expiration Date 06/19/2018
By *[Signature]*
Miami Dade Product Control

GLAZING OPTIONS

MAX. AREA OF GLASS INSERTS.....13.4 SQ. FT.
MAX. AREA OF WOOD INSERTS.....8.5 SQ. FT.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0514-19
Expiration Date 06/19/2013
By *[Signature]*
Miami Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
MAY 08 2012
[Signature]


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL W08-35FPG

OUT-SWING WOOD PATIO DOOR (N.I.)
F.P.G. WHOLESALE INC.
7190 CORAL WAY
MIAMI, FLORIDA 33155
TEL (305) 266-2296 FAX (305) 261-6540

revisions:	no.	date	by	description
	A	05.16.08	REV. PER BCCO COMMENTS	
	B	04.27.12	UPDATED TO 2010 FBC	

date: 04-04-08
scale: -
dr. by: HAMID
chk. by:

drawing no.
W08-35
sheet 2 of 8

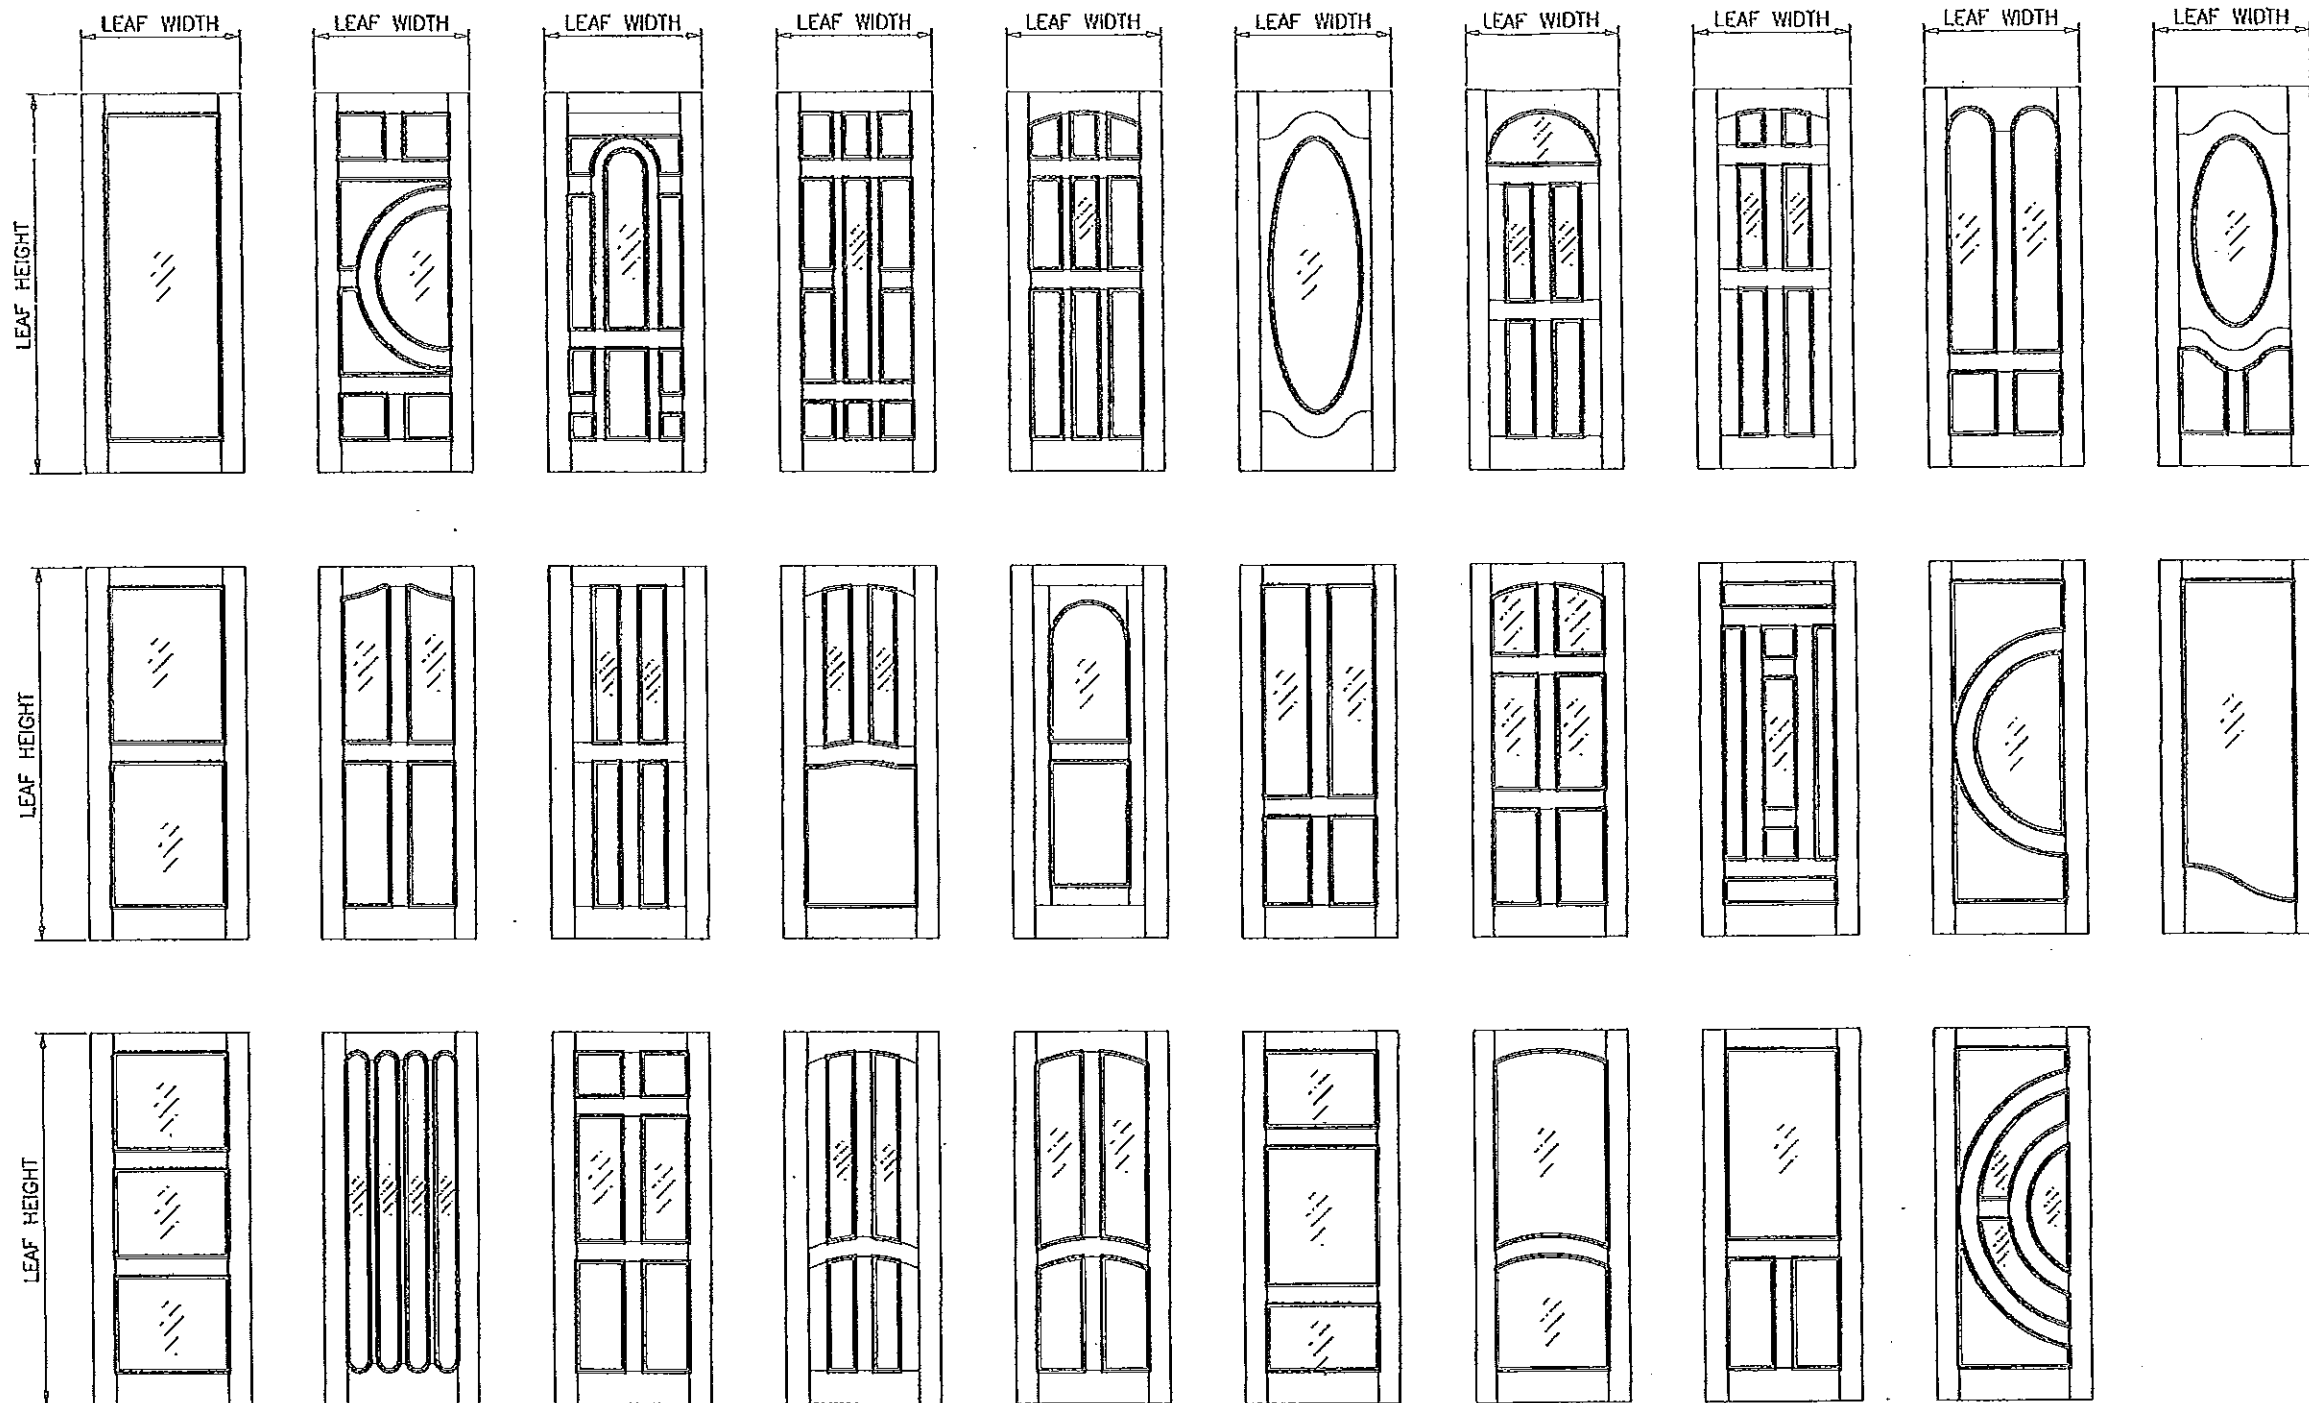

LEAF PATTERNS AS SHOWN ABOVE OR SIMILAR WITH VARIOUS FINISHES AND DECORATIVE MOULDINGS GLAZED WITH GLASS OR SOLID WOOD INSERTS ARE ALSO ALLOWED.

MINIMUM DIMENSIONS:

STILES AND TOP RAIL.....6-3/4"
 LOCK STILES.....6-3/4"
 INTERMEDIATE RAILS.....8-1/2"
 INTERMEDIATE STILES.....3-1/2"
 BOTTOM RAILS.....9-1/2"

LIMIT MAX. AREA OF GLASS INSERTS.....13.4 SQ. FT.
 LIMIT MAX. AREA OF WOOD INSERTS.....8.5 SQ. FT.

SEE SHEET 2 FOR DESIGN LOAD CAPACITY.


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0514.19
 Expiration Date 06/19/2013
 By *Healy A. Healy*
 Miami Dade Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538


MAY 08 2012

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 13-0510.02
 Expiration Date 06/19/2018
 By *Healy A. Healy*
 Miami Dade Product Control



AL-FAROOQ CORPORATION ENGINEERS & PRODUCT DEVELOPMENT 1235 S.W. 87 AVE MIAMI, FLORIDA 33174 TEL (305) 264-8100 FAX (305) 262-6978 COMP-ANL\W08-35FPG			
OUT-SWING WOOD PATIO DOOR (N.I.) F.P.G. WHOLESALERS INC. 7190 CORAL WAY MIAMI, FLORIDA 33155 TEL (305) 266-2296 FAX (305) 261-6540			
revisions: no. date by description A 05.16.08 REV. PER BOCO COMMENTS B 04.27.12 NO CHANGE THIS SHEET	date: 04-04-08 scale: - dr. by: HAMID chk. by:	drawing no. W08-35 sheet 3 of 8	

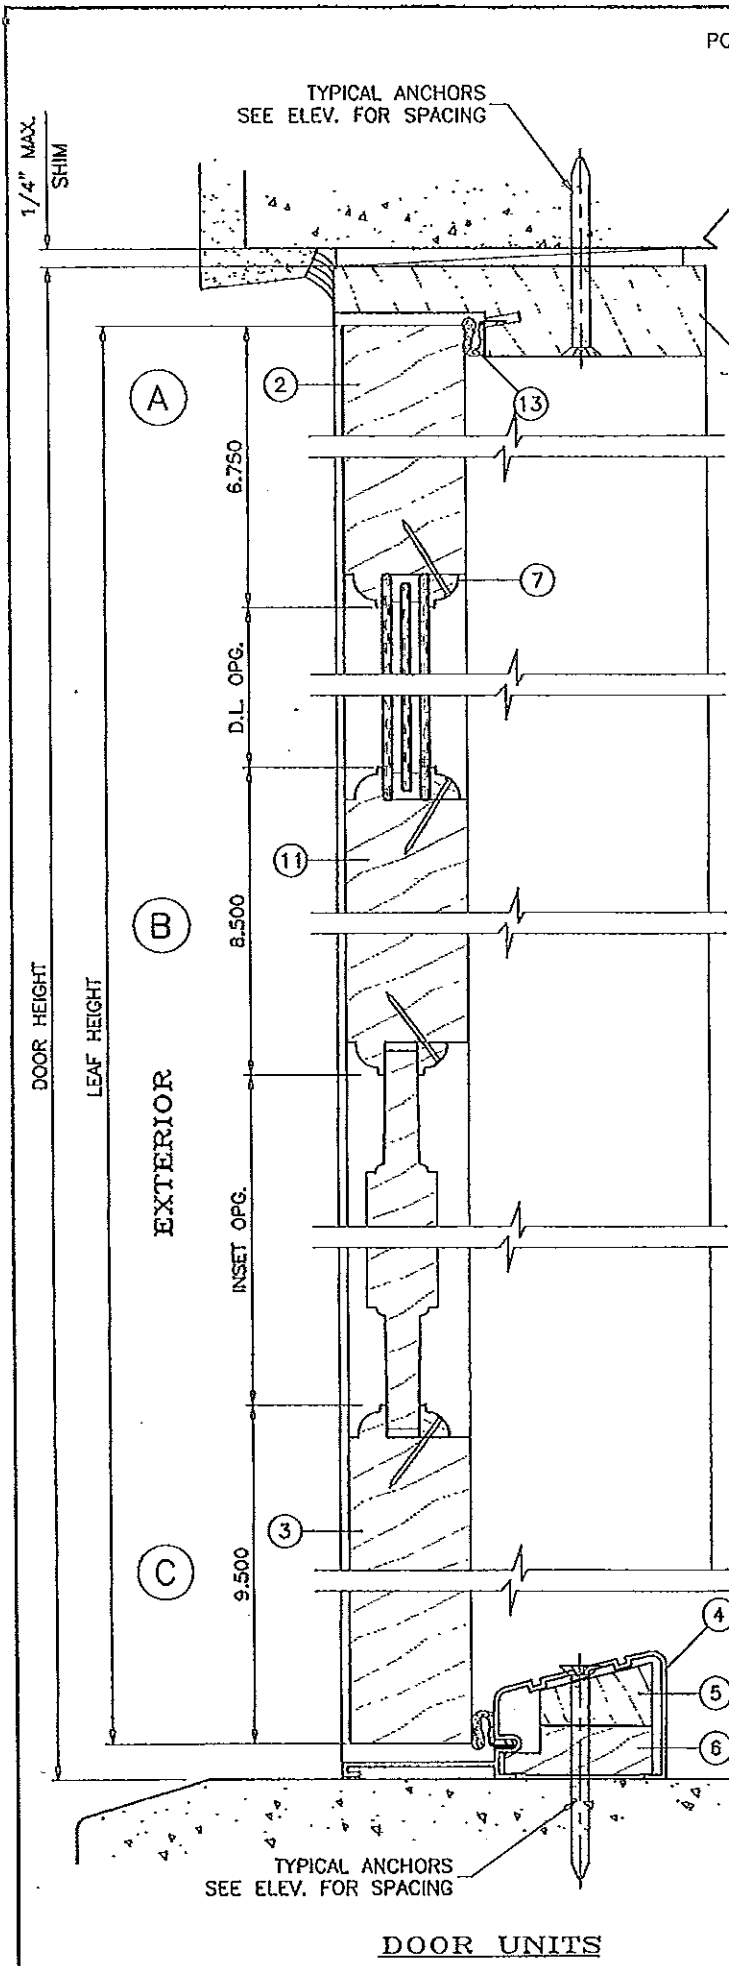

DOOR UNITS

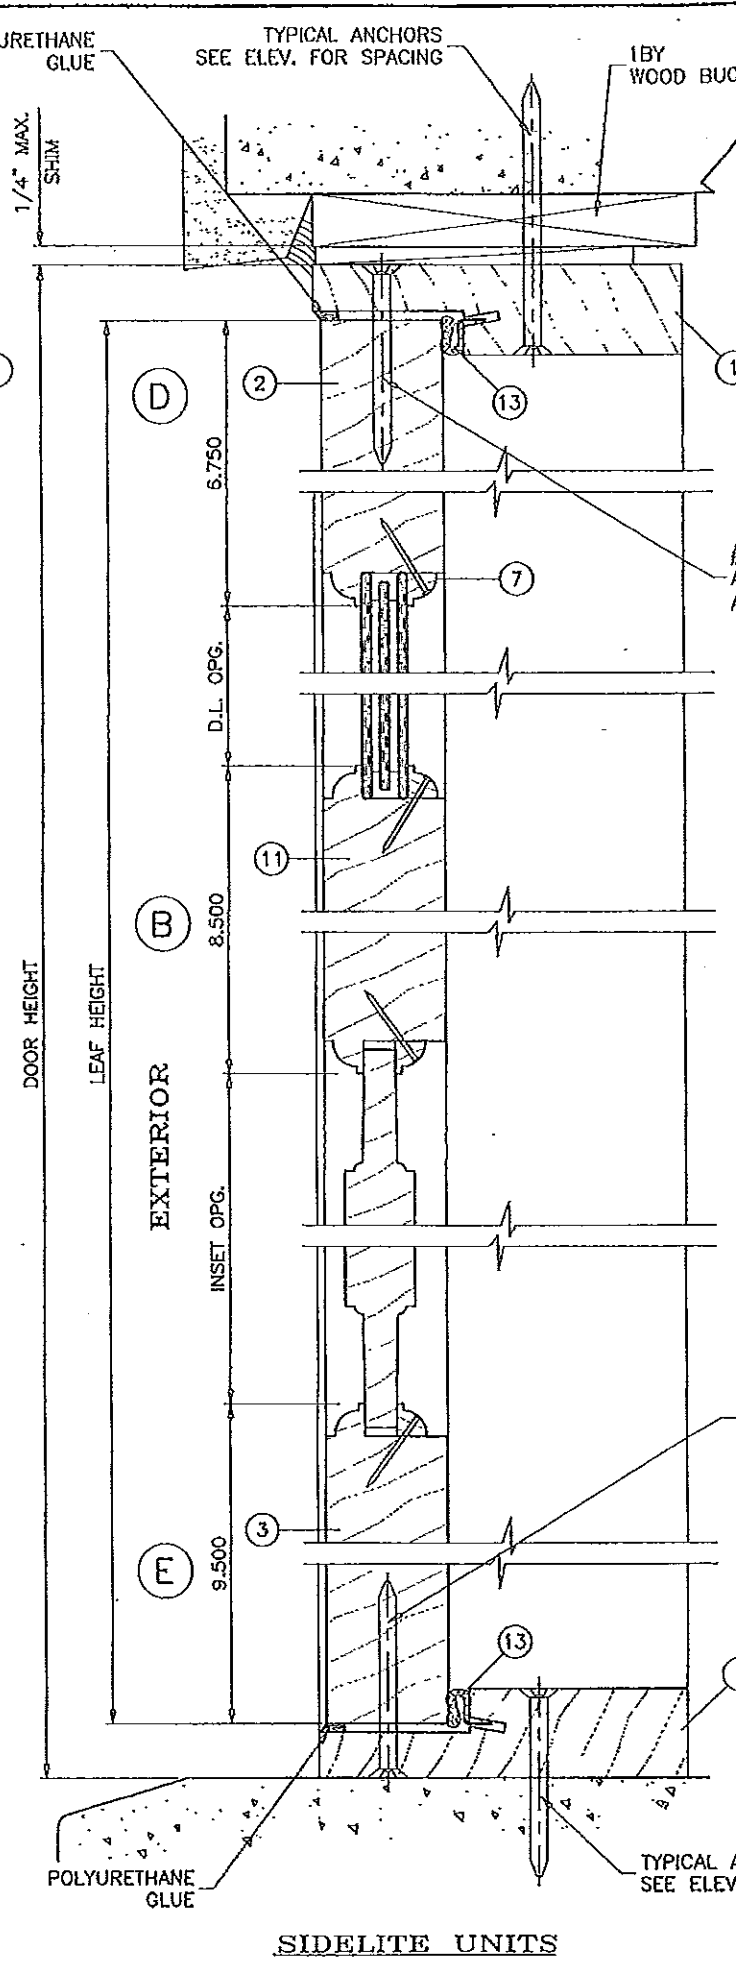

SIDELITE UNITS

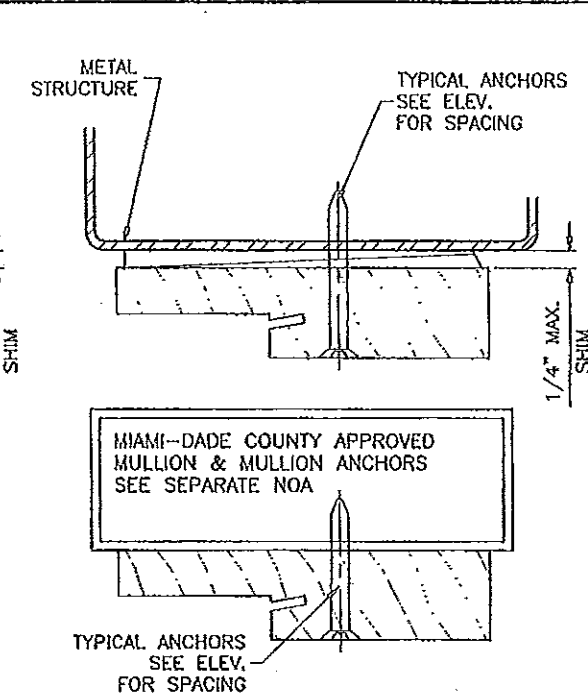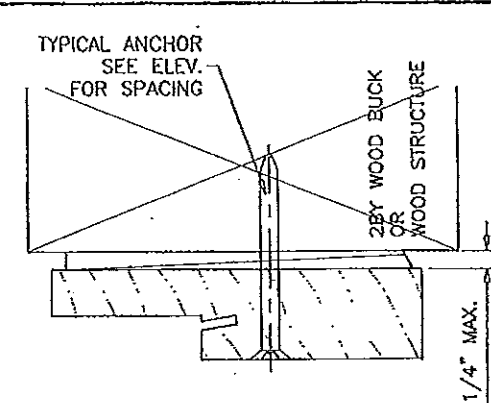

WOOD BUCKS AND METAL STRUCTURE NOT BY F.P.G. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = 1/8")
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 1" MIN.
 INTO WOOD STRUCTURE = 3/4" MIN.
 INTO METAL STRUCTURE = 1/2" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0514.19
 Expiration Date 06/19/2013
 By *Helmy A. M. M.*
 Miami Dade Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 MAY 08 2012

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 13-0510.02
 Expiration Date 06/19/2018
 By *Helmy A. M. M.*
 Miami Dade Product Control



AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W08-35FPG

OUT-SWING WOOD PATIO DOOR (N.I.)
F.P.G. WHOLESALE INC.
 7190 CORAL WAY
 MIAMI, FLORIDA 33155
 TEL (305) 266-2296 FAX (305) 261-6540

no	date	by	description
A	05.16.08	REV. PER BCCO COMMENTS	
B	04.27.12	UPDATED TO 2010 FBC	

date: 04-04-08
 scale: 3/8" = 1"
 dr. by: HAMID
 chg. by:

drawing no.
W08-35
 sheet 4 of 8

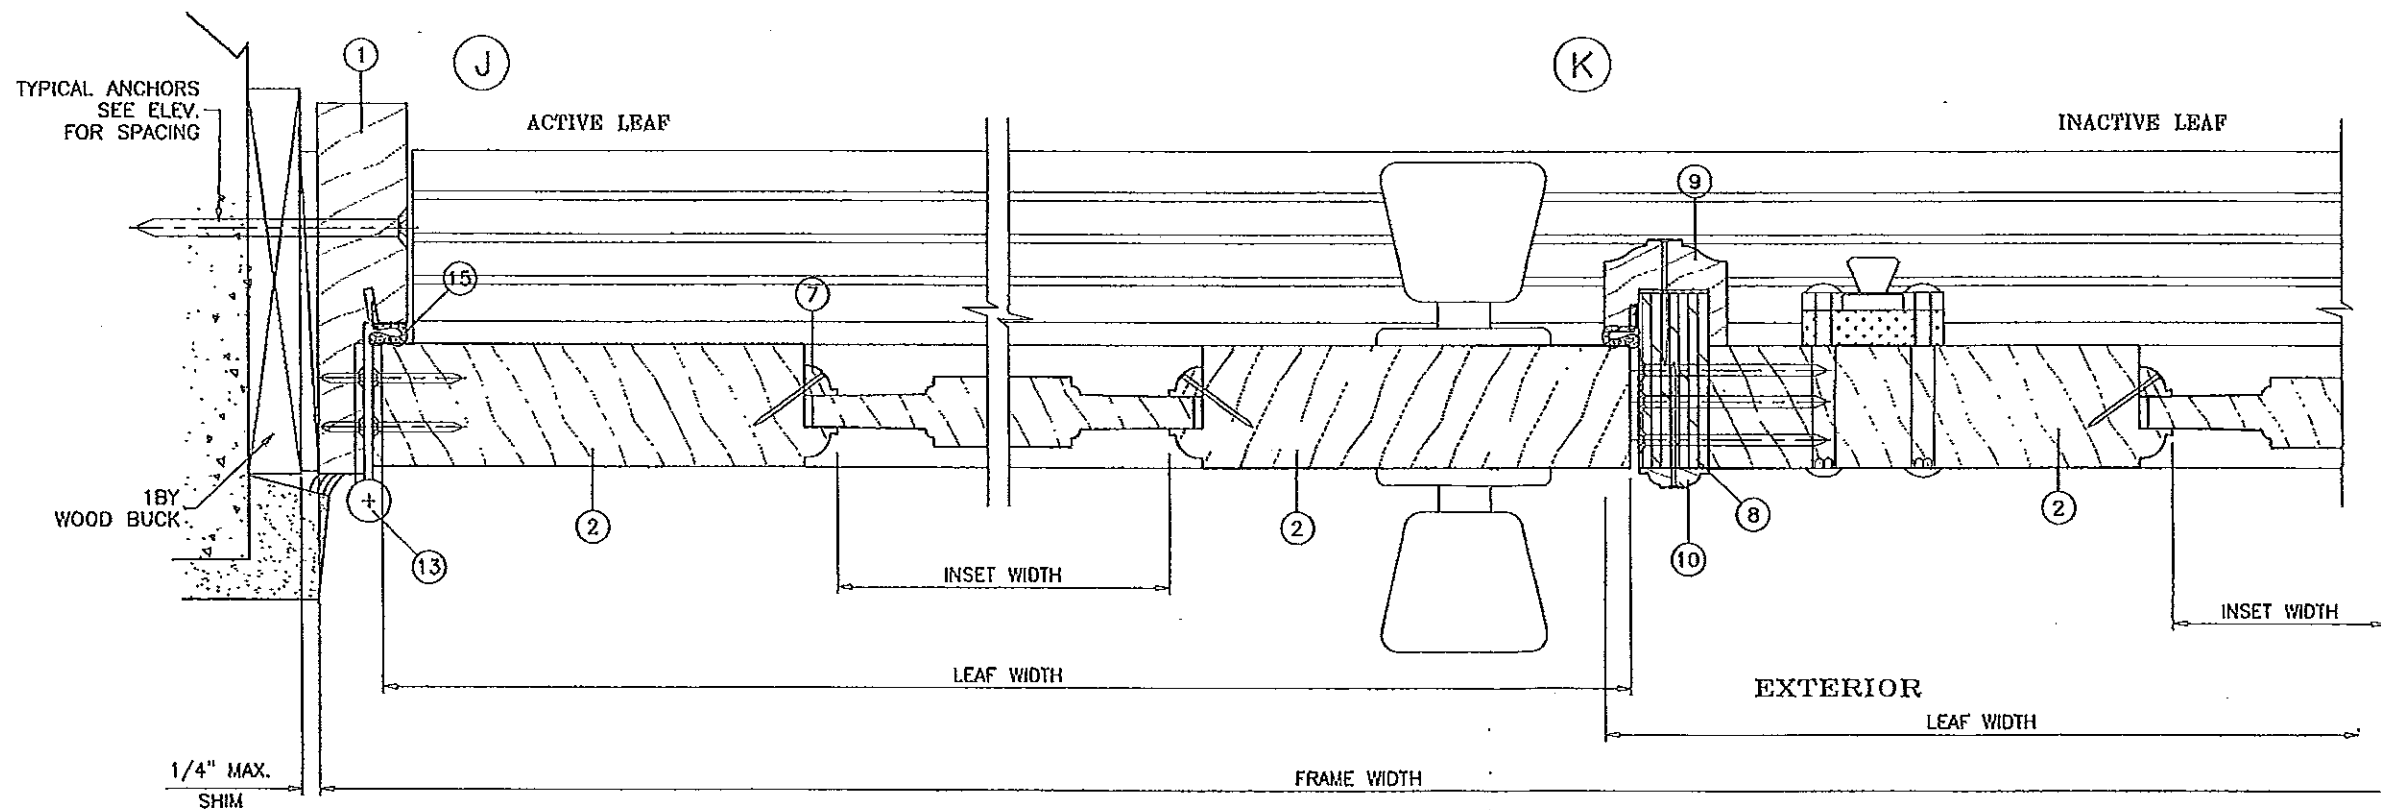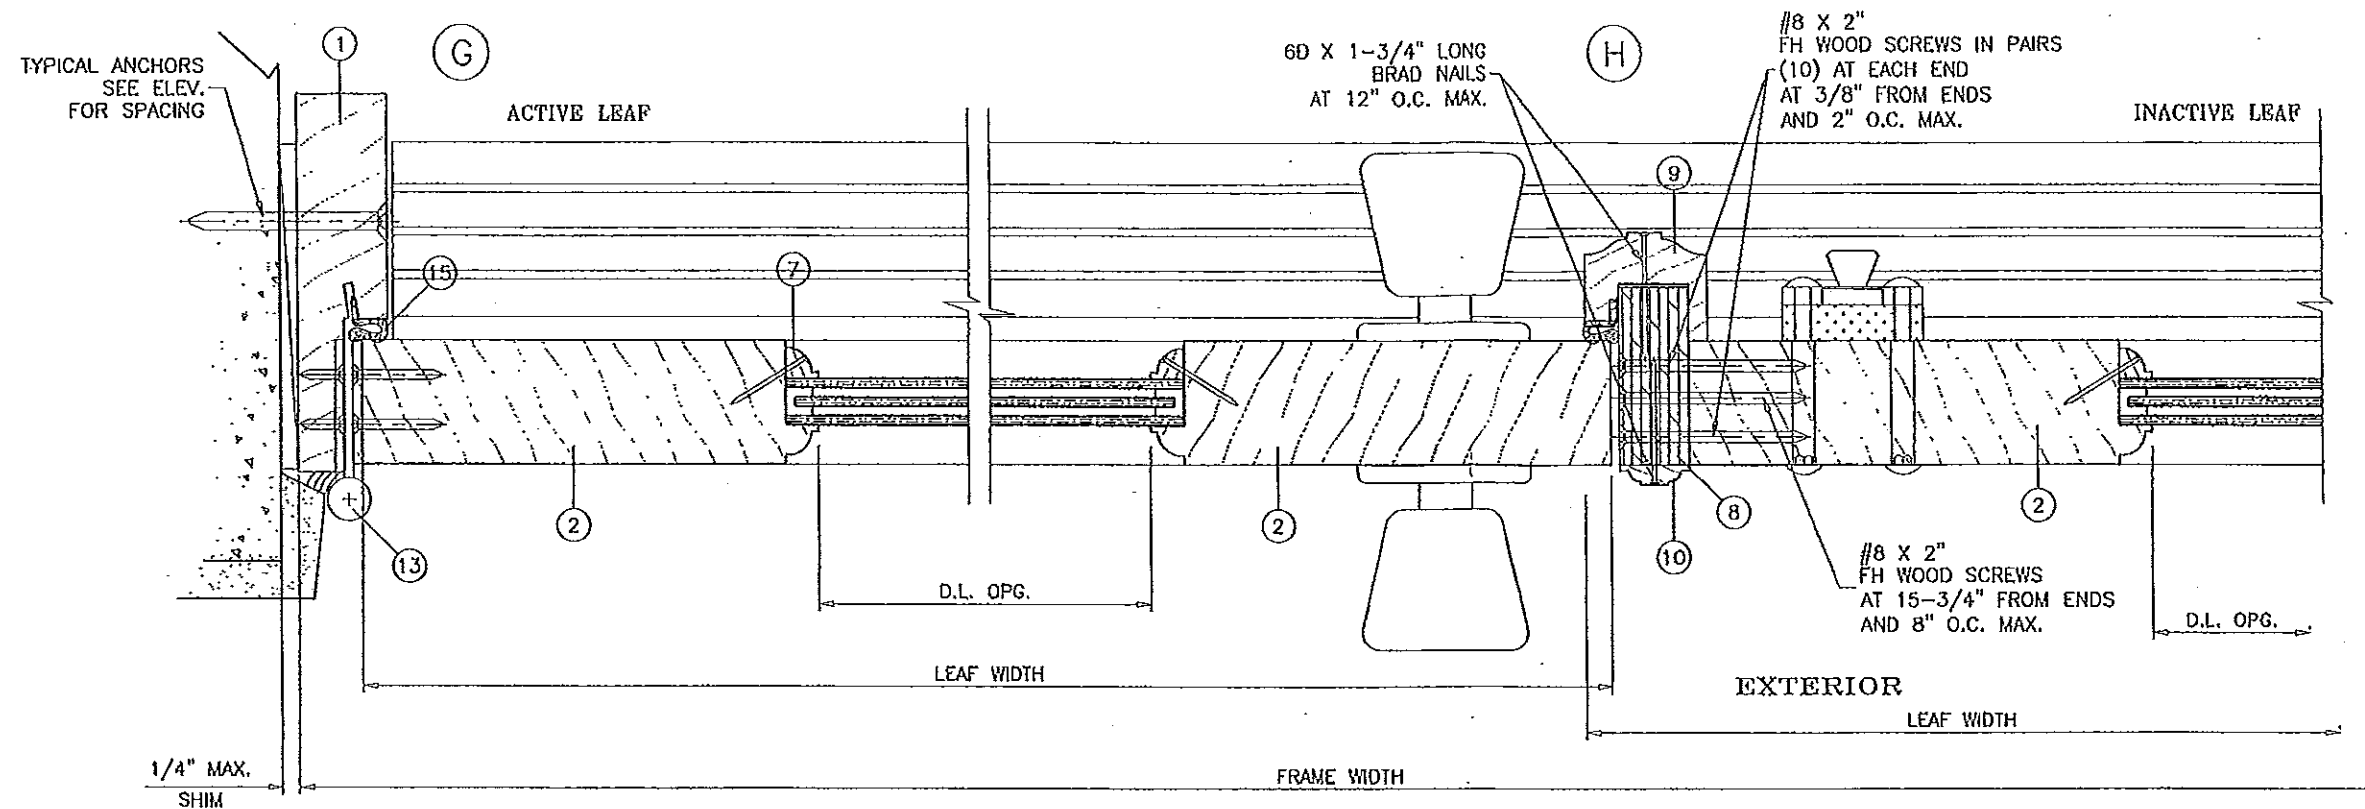

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0514-19
Expiration Date 06/19/2013
By *[Signature]*
Miami Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

MAY 08 2012

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 13-0510-02
Expiration Date 06/19/2018
By *[Signature]*
Miami Dade Product Control


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL W08-35FPG

OUT-SWING WOOD PATIO DOOR (N.I.)
F.P.G. WHOLESALE INC.
7190 CORAL WAY
MIAMI, FLORIDA 33155
TEL (305) 266-2296 FAX (305) 261-6540

NO.	DATE	BY	DESCRIPTION
A	05.16.08	REV. PER BCCO COMMENTS	
B	04.27.12	NO CHANGE THIS SHEET	

date: 04-04-08
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W08-35
sheet 5 of 8

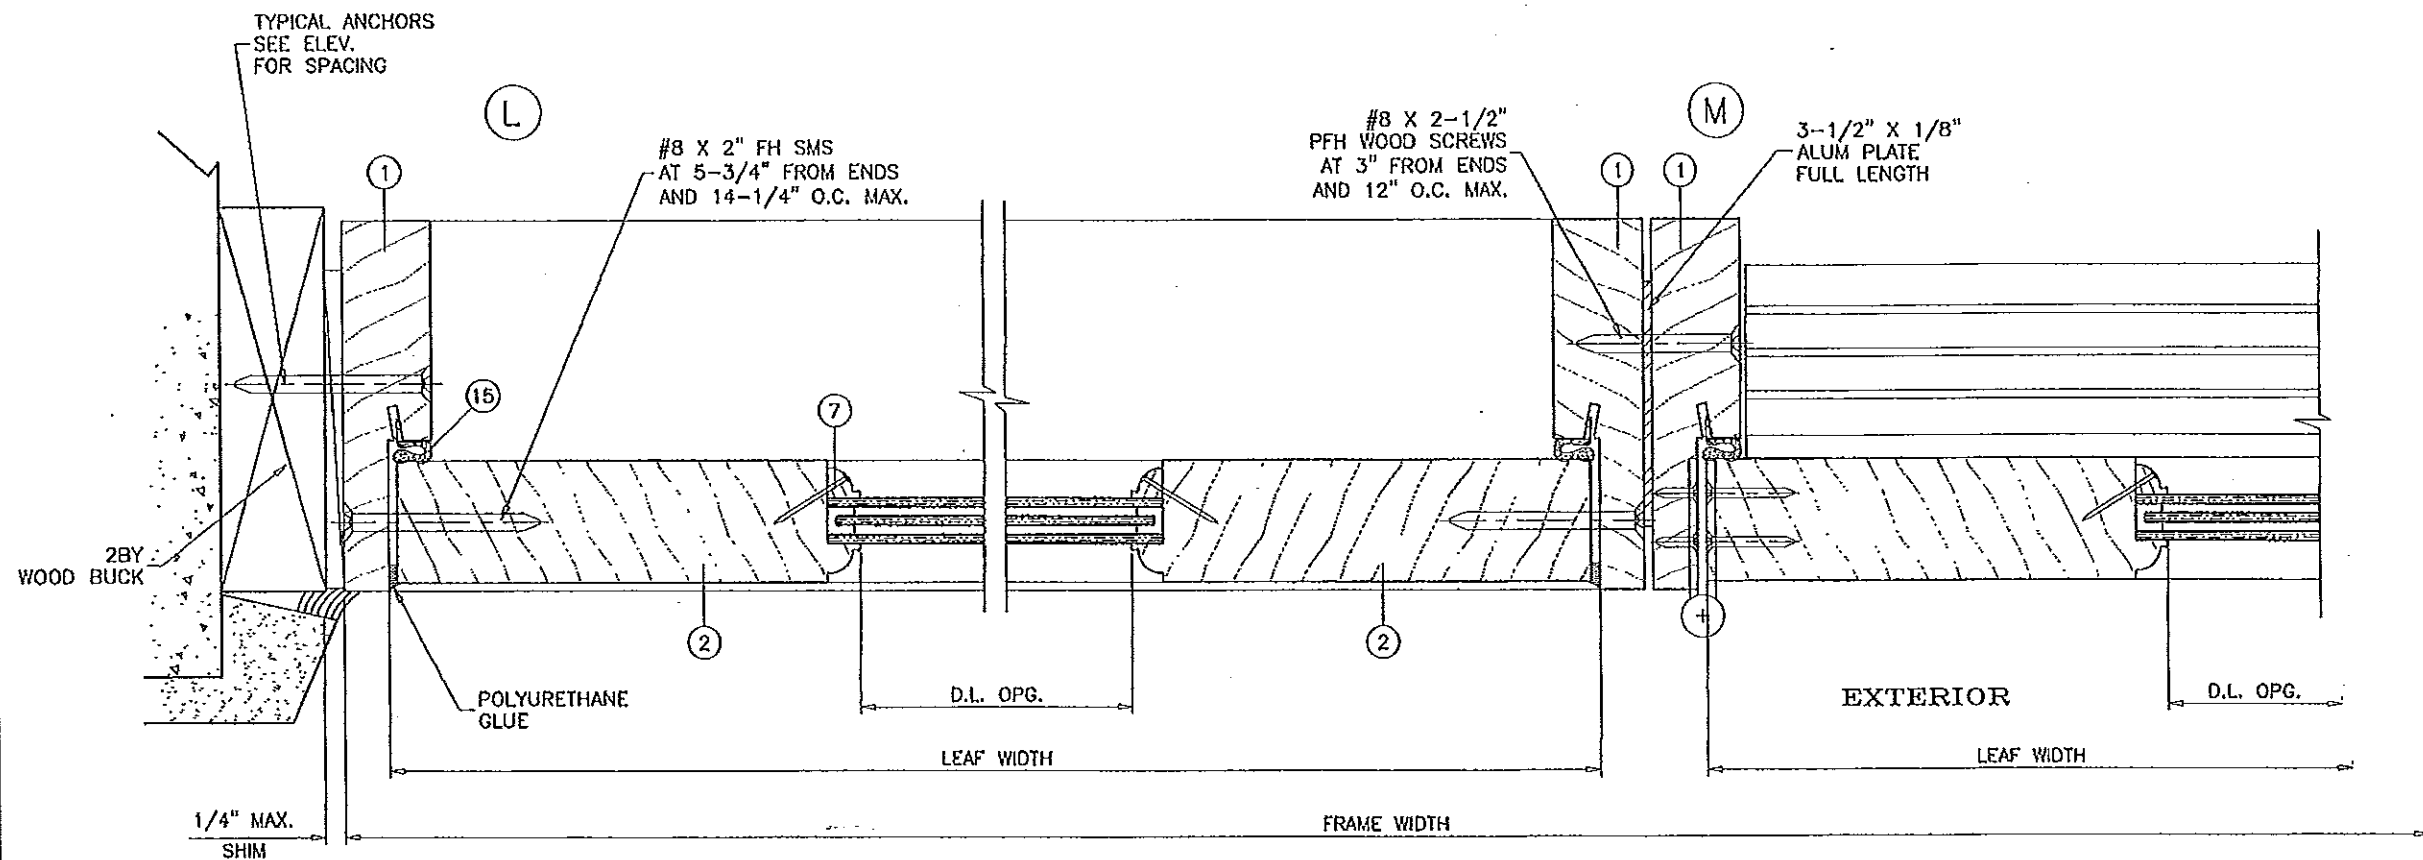

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0514.19
Expiration Date 06/19/2013
By *[Signature]*
Miami Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
[Signature]
MAY 08 2012

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 13-0510.02
Expiration Date 06/19/2018
By *[Signature]*
Miami Dade Product Control


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL W08-35FPG

OUT-SWING WOOD PATIO DOOR (N.I.)
F.P.G. WHOLESALE INC.
7190 CORAL WAY
MIAMI, FLORIDA 33155
TEL (305) 266-2296 FAX (305) 261-6540


revisions:		
no	date	by description
A	05.16.08	REV. PER BOCO COMMENTS
B	04.27.12	NO CHANGE THIS SHEET

date: 04-04-08
scale: 3/8" = 1"
dr. by: HAMID
chk. by:


drawing no.
W08-35
sheet 6 of 8

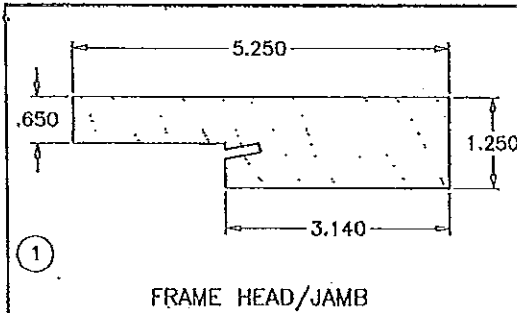


FRAME HEAD/JAMB

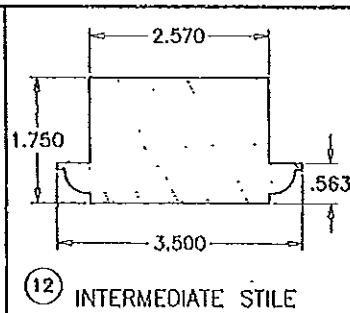


INTERMEDIATE STILE

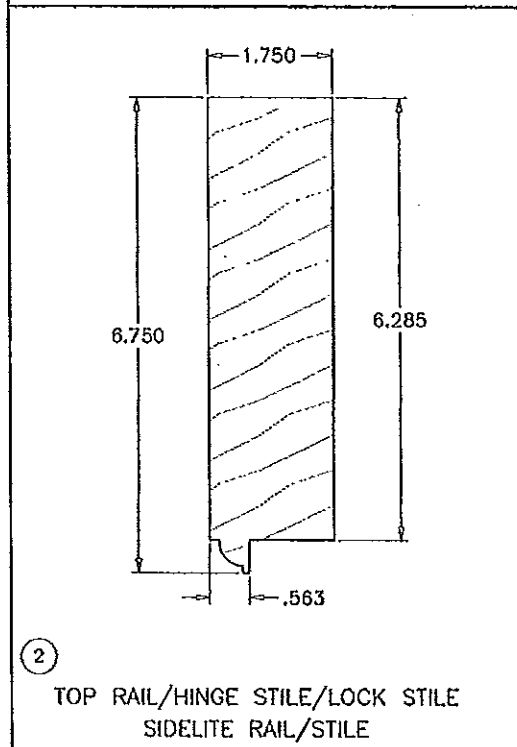


TOP RAIL/HINGE STILE/LOCK STILE
SIDELITE RAIL/STILE

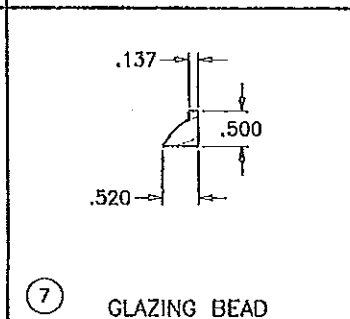


GLAZING BEAD

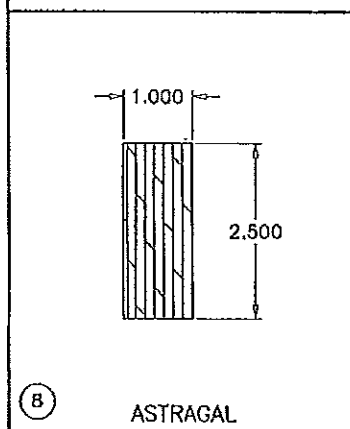


ASTRAGAL

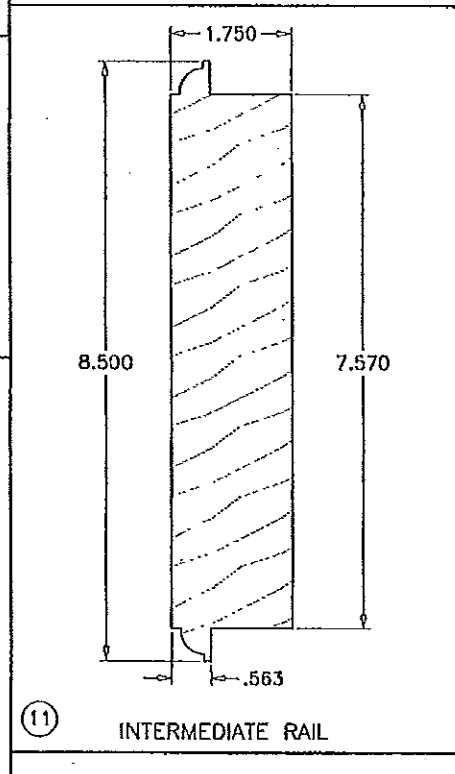


INTERMEDIATE RAIL

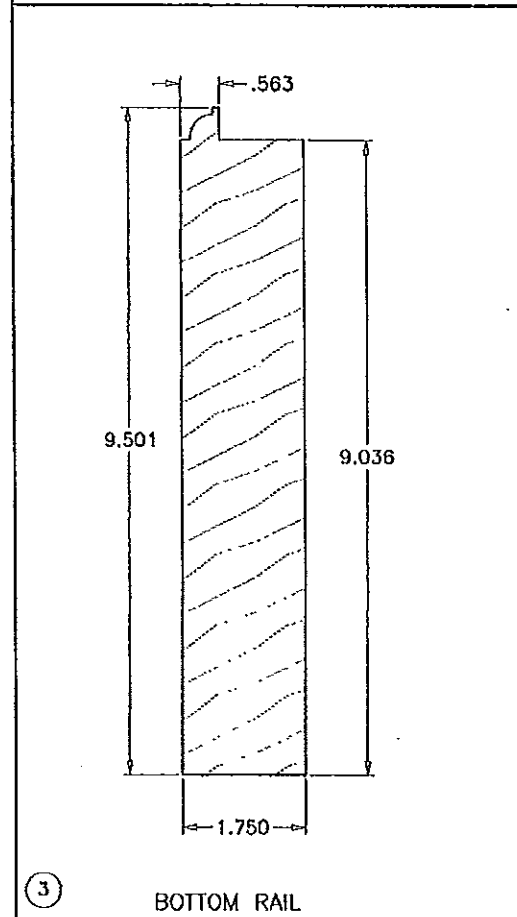


BOTTOM RAIL

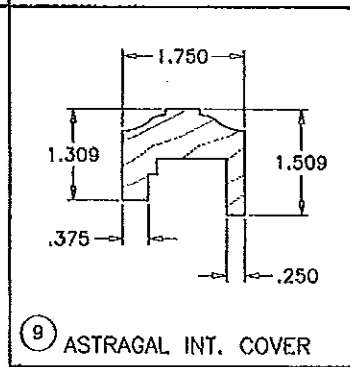

ASTRAGAL INT. COVER

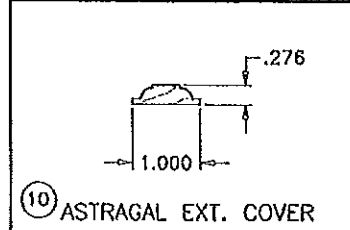


ASTRAGAL EXT. COVER

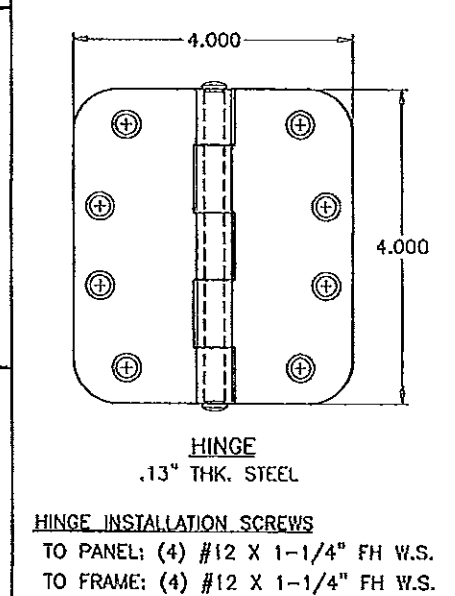


HINGE
.13" THK. STEEL


HINGE INSTALLATION SCREWS
TO PANEL: (4) #12 X 1-1/4" FH W.S.
TO FRAME: (4) #12 X 1-1/4" FH W.S.

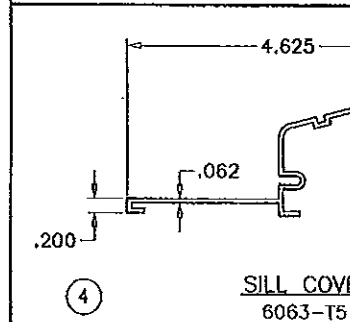

SILL COVER
6063-T5

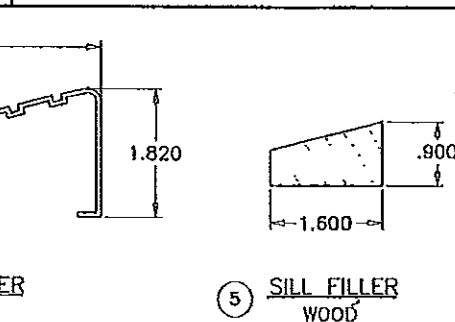

SILL FILLER
WOOD

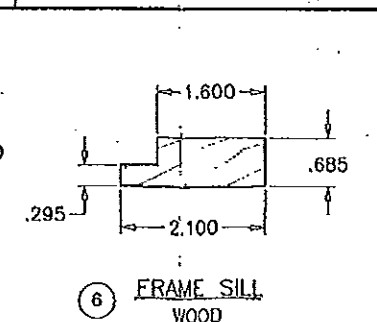

FRAME SILL
WOOD

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	--	3/ DOOR	FRAME HEAD/JAMB	WOOD	--
2	--	AS REQD.	TOP RAIL/HINGE & LOCK STILE/SIDELITE STILE	WOOD	--
3	--	1/ LEAF	BOTTOM RAIL	WOOD	--
4	--	1	SILL COVER	ALUMINUM	--
5	--	1	SILL FILLER	WOOD	--
6	--	1	FRAME SILL	WOOD	--
7	--	AS REQD.	GLAZING BEAD	WOOD	--
8	--	1	ASTRAGAL	PLYWOOD	AB MARINE GRADE 13 PLY
9	--	1	ASTRAGAL INTERIOR COVER	WOOD	--
10	--	--	ASTRAGAL EXTERIOR COVER	WOOD	--
11	--	AS REQD.	INTERMEDIATE RAIL	WOOD	--
12	--	AS REQD.	INTERMEDIATE STILE	WOOD	--
13	--	4/ LEAF	HINGE	STEEL	--
14	#10 X 3"	3/ CORNER	FRAME ASSEMBLY SCREWS FLAT HEAD	--	--
15	QEBD650	AS REQD.	FRAME W'STRIPPING, FOAM TIP	PVC	Q--LON

WOOD OPTIONS

- 1- SOUTHERN CHERRY
- 2- ANDEAN WALNUT
- 3- TROPICAL WALNUT
- 4- WHITE OAK
- 6- YESQUERO

SPECIFIC GRAVITY = 0.50 MIN. (E=1,400,000)
GRADE = 2 MIN.
MOISTURE CONTENT = 12% MAX.

SEALANT:

FRAME & PANEL CORNERS SEALED WITH DUROLOK CM902 SEALANT.
FRAME AND PANEL CLADDING GLUED WITH TECHNOBOND L560S.

HINGES: 4" X 4" X .130" THK. HINGE
4 PER LEAF AT 9-3/4" FROM EACH END
AND 25-1/2" O.C. MAX.

LOCKS:

CONVENTIONAL LOCKSET WITH DEAD BOLT AT ACTIVE LEAF LOCK STILE
KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR
PASSAGE LOCK AT 36" FROM BOTTOM,
DEAD BOLT AT 42" FROM BOTTOM

- OPTION 1 = EMTEK CORTINA KEYED ENTRY DOOR LEVERSET
- OPTION 2 = KWIKSET POLO KEYED ENTRY DOOR KNOBSET
- OPTION 3 = BALDWIN KEYED ENTRY DOOR LEVERSET

MANUALLY OPERATED SURFACE BOLTS BY 'DELTANA' AT TOP AND
BOTTOM OF ACTIVE LEAF.
(MUST BE ENGAGED DURING PERIODS OF HURRICANE WARNING)

MANUALLY OPERATED CONCEALED FLUSH BOLTS AT TOP & BOTTOM
OF INACTIVE LEAF.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0514.19
Expiration Date 06/19/2013
By: *[Signature]*
Miami Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 13-0510.02
Expiration Date 06/19/2018
By: *[Signature]*
Miami Dade Product Control

MAY 08 2012

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6378

COMP--ANL\W08-35FFPG

OUT-SWING WOOD PATIO DOOR (N.I.)


F.P.G. WHOLESALE INC.
7190 CORAL WAY
MIAMI, FLORIDA 33155
TEL (305) 266-2296 FAX (305) 261-6540

revisions:



no	date	by	description
A	05.16.08	REV. PER BCCO COMMENTS	
B	04.27.12	UPDATED TO 2010 REC	

date: 04-04-08
scale: 3/8" = 1"
dr. by: HAMID
chk. by:



drawing no.
W08-35
sheet 7 of 8

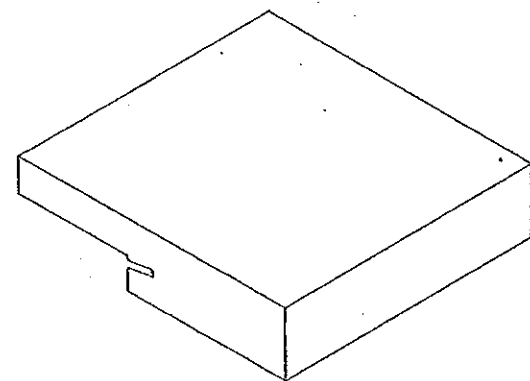


FRAME TOP CORNER

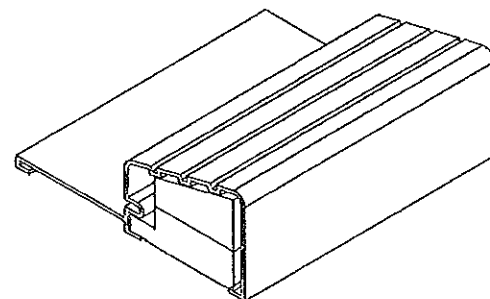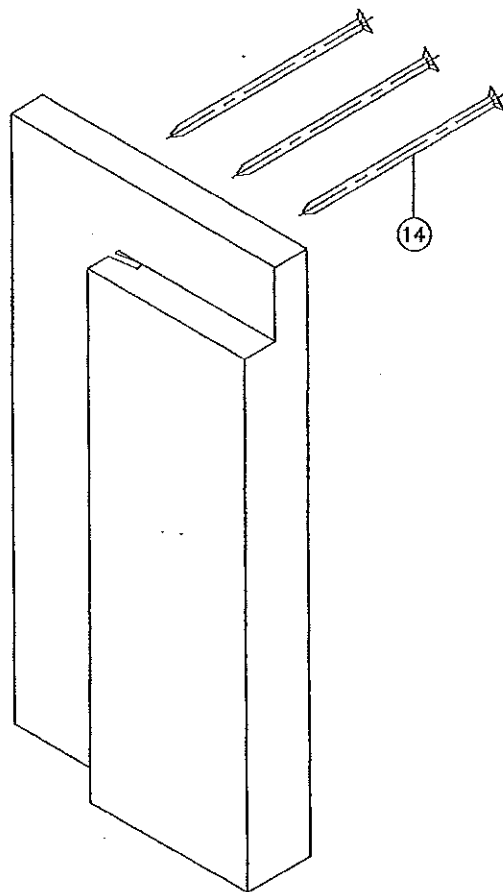

FRAME BOTTOM CORNER

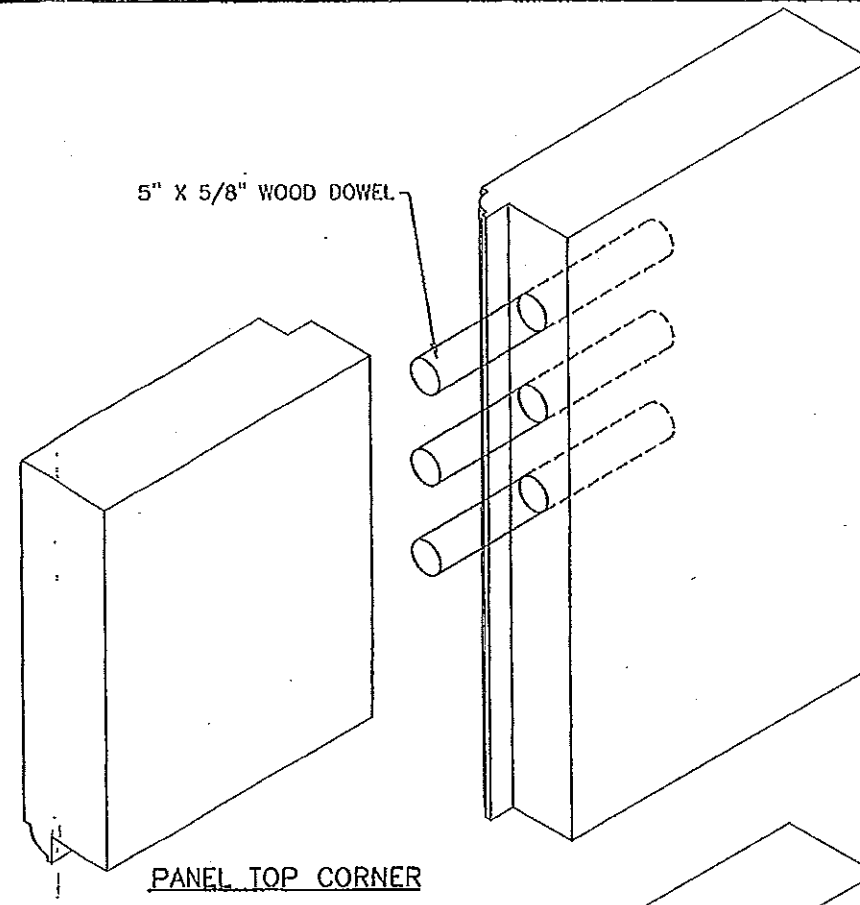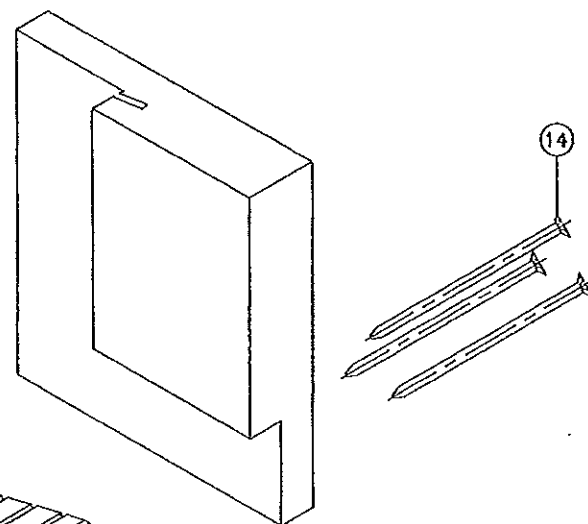

PANEL TOP CORNER

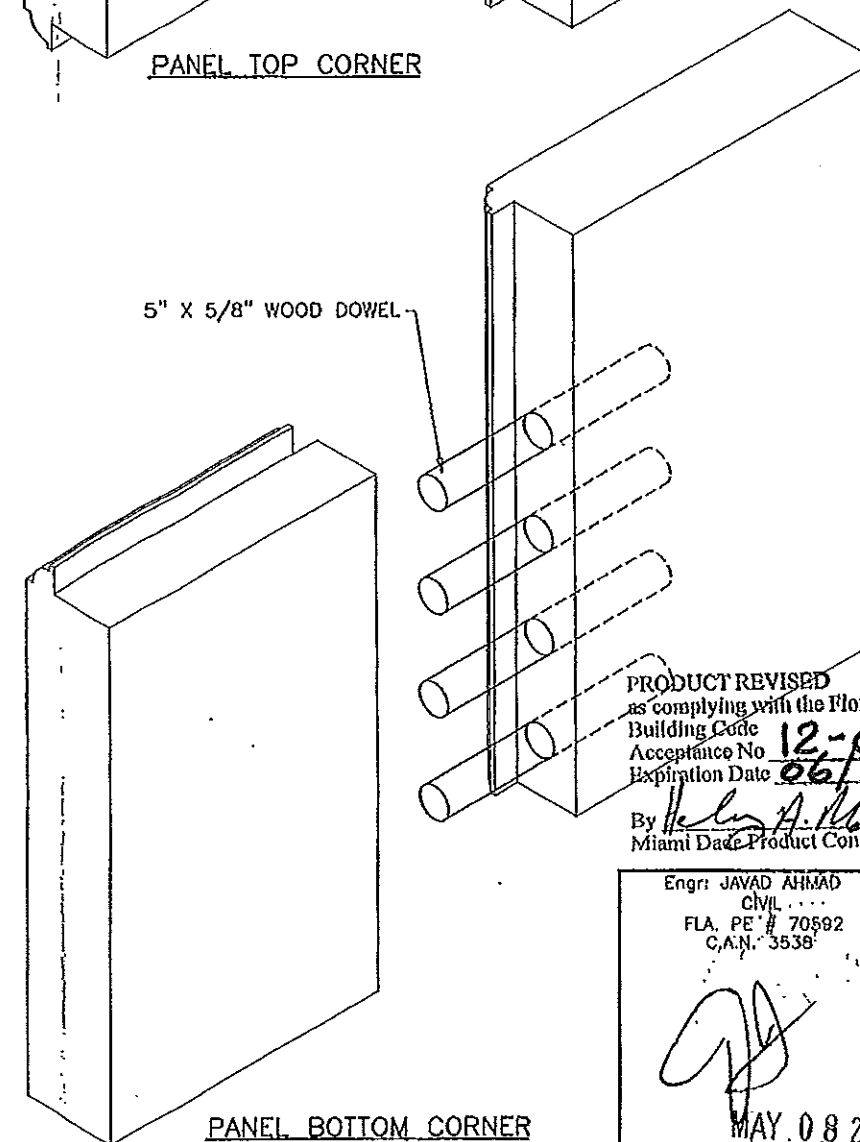

PANEL BOTTOM CORNER

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0514.19
Expiration Date 06/19/2013
By *[Signature]*
Miami Dade Product Control

date: 04-04-08
scale: 3/8" = 1"
dr. by: HAMID
chk. by:
drawing no.
W08-35
sheet 8 of 8

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 13-0510.02
Expiration Date 06/19/2018
By *[Signature]*
Miami Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6973
COMP-ANL\W08-35FFPG

OUT-SWING WOOD PATIO DOOR (N.I.)
F.P.G. WHOLESALE INC.
7190 CORAL WAY
MIAMI, FLORIDA 33155
TEL (305) 266-2296 FAX (305) 261-6540

NO.	DATE	BY	DESCRIPTION
A	05.16.08		NO CHANGE THIS SHEET
B	04.27.12		NO CHANGE THIS SHEET

date: 04-04-08
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W08-35
sheet 8 of 8